

Brightness sensor LUNA 134 KNX



LUNA 134	1349200
----------	---------

Contents

1	<i>Functional characteristics</i>	3
1.1	Special features	3
2	<i>Technical data</i>	4
3	<i>The "LUNA 134 V1.0".application program</i>	5
3.1	Selection in the product database	5
3.2	Communication objects	6
3.2.1	Description of objects.....	18
3.3	Parameter.....	25
3.3.1	Parameter pages.....	25
3.3.2	Parameter description	26
4	<i>Typical applications:</i>	44
4.1	Simple twilight switch	44
4.1.1	Devices:	44
4.1.2	Overview	44
4.1.3	Objects and links	44
4.1.4	Important parameter settings	45
4.2	Switching 2-zone internal lighting depending on external brightness.	46
4.2.1	Devices:	46
4.2.2	Overview	46
4.2.3	Objects and links	46
4.2.4	Important parameter settings	47
5	<i>Appendix</i>	48
5.1	Allocate sensors	48
6	<i>Operating instructions</i>	50

1 Functional characteristics

LUNA 134 measures the brightness with 1, 2 or 3 external data bus sensors. The measured values can be sent to the bus.

LUNA 134 has the following channel types:

- 10 brightness-dependent switching channels
- 4 threshold channels with per cent, 8-/16- bit counter values or floating-point number (DPT 9.xxx)
- 6 logic channels (AND, OR, XOR)

See attachment for a detailed description of the channel types.

1.1 Special features

- Up to 3 external **data bus** brightness sensors can be connected (see attachment).
- Switching channels can react to the values of the individual sensors as well as the highest value of all the sensors.
- Switching channels with delay with exceeding and falling below thresholds
- Logic channels can be configured with 4 input objects + internal link with status of the switching, threshold and logic channels.
- Joint data bus connection for Luna 134 sensors and TR 648 top2 DCF receiver possible (see figure).

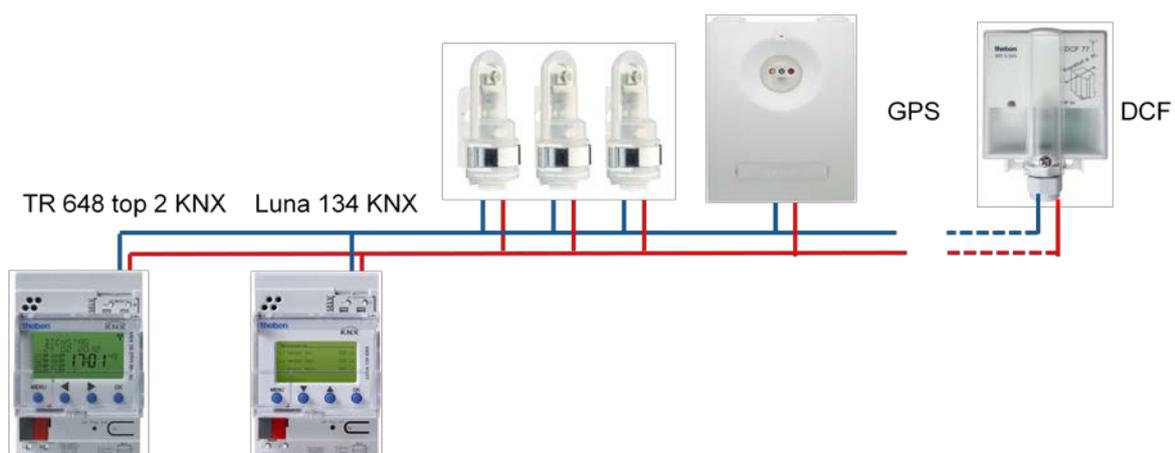


Figure 1

2 Technical data

Operating voltage	110 – 240 V AC
Frequency	50 – 60 Hz
Operating voltage KNX	Bus voltage, ≤10 mA
Standby output	0.8 W
Brightness measuring range	1 – 100,000 lx
On/off switching delay	0 – 60 min
Number of channels	10
Width	3 module
Installation type	DIN-rail
Connection type	Bus connection: KNX bus terminal sensor connection: DuoFix plug-in terminals
Max. cable cross-section	2 x 0.75 mm ²
Max. line length to sensor	100 m
Ambient temperature	-5 °C ... +45 °C
Protection class	II
IP rating	IP 20

3 The "LUNA 134 V1.0".application program

3.1 Selection in the product database

Manufacturer	THEBEN AG
Product family	Output
Product type	LUNA 134
Program name	LUNA 134 V1.0

The ETS database can be found on our downloads page: www.theben.de/downloads.

Table 1

Number of communication objects:	171
Number of group addresses:	255
Number of associations:	255

3.2 Communication objects

Table 2

No.	Object name	Function	Type DPT	Flags			
				C	R	W	T
0	<i>Brightness value sensor 1</i>	<i>Physical value</i>	2 byte 9,004	C	R	-	T
1	<i>Brightness value sensor 2</i>	<i>Physical value</i>	2 byte 9,004	C	R	-	T
2	<i>Brightness value sensor 3</i>	<i>Physical value</i>	2 byte 9,004	C	R	-	T
3	<i>Maximum brightness value</i>	<i>Physical value</i>	2 byte 9,004	C	R	-	T
17	<i>Brightness sensors status</i>	<i>0=OK, 1=min. 1 sensor defective</i>	1 bit 1.001	C	R	-	T
20	<i>C1.1 switching channel</i>	<i>Switching</i>	1 bit 1.001	C	R	-	T
		<i>Value</i>	1 byte 5,010	C	R	-	T
		<i>priority</i>	2 bit 2,001	C	R	-	T
21	<i>C1.2 switching channel</i>	<i>Switching</i>	1 bit 1.001	C	R	-	T
		<i>Value</i>	1 byte 5,010	C	R	-	T
		<i>priority</i>	2 bit 2,001	C	R	-	T
22	<i>C1 lock</i>	<i>Disable = 0</i>	1 bit 1.001	C	R	W	-
		<i>Disable = 1</i>	1 bit 1.001	C	R	W	-
23	<i>C1 brightness threshold</i>	<i>set/query</i>	2 byte 9,004	C	R	W	T
		<i>Request</i>	2 byte 9,004	C	R	-	T
24	<i>C2 1 switching channel</i>	<i>Switching</i>	1 bit 1.001	C	R	-	T
		<i>Value</i>	1 byte 5,010	C	R	-	T
		<i>priority</i>	2 bit 2,001	C	R	-	T

Continuation:

No.	Object name	Function	Type DPT	Flags			
				C	R	W	T
25	<i>C2 2 switching channel</i>	<i>Switching</i>	1 bit 1,001	C	R	-	T
		<i>Value</i>	1 byte 5,010	C	R	-	T
		<i>priority</i>	2 bit 2,001	C	R	-	T
26	<i>C2 lock</i>	<i>Disable = 0</i>	1 bit 1,001	C	R	W	-
		<i>Disable = 1</i>	1 bit 1,001	C	R	W	-
27	<i>C2 brightness threshold</i>	<i>set/query</i>	2 byte 9,004	C	R	W	T
		<i>Request</i>	2 byte 9,004	C	R	-	T
28	<i>C3 1 switching channel</i>	<i>Switching</i>	1 bit 1,001	C	R	-	T
		<i>Value</i>	1 byte 5,010	C	R	-	T
		<i>priority</i>	2 bit 2,001	C	R	-	T
29	<i>C3 2 switching channel</i>	<i>Switching</i>	1 bit 1,001	C	R	-	T
		<i>Value</i>	1 byte 5,010	C	R	-	T
		<i>priority</i>	2 bit 2,001	C	R	-	T
30	<i>C3 lock</i>	<i>Disable = 1</i>	1 bit 1,001	C	R	W	-
		<i>Disable = 0</i>	1 bit 1,001	C	R	W	-
31	<i>C3 brightness threshold</i>	<i>set/query</i>	2 byte 9,004	C	R	W	T
		<i>Request</i>	1 bit 1,001	C	R	-	T
32	<i>C4 1 switching channel</i>	<i>Switching</i>	1 bit 1,001	C	R	-	T
		<i>Value</i>	1 byte 5,010	C	R	-	T
		<i>priority</i>	2 bit 2,001	C	R	-	T

Continuation:

No.	Object name	Function	Type DPT	Flags			
				C	R	W	T
33	<i>C4 2 switching channel</i>	<i>Switching</i>	1 bit 1,001	C	R	-	T
		<i>Value</i>	1 byte 5,010	C	R	-	T
		<i>priority</i>	2 bit 2,001	C	R	-	T
34	<i>C4 lock</i>	<i>Disable = 0</i>	1 bit 1,001	C	R	W	-
		<i>Disable = 1</i>	1 bit 1,001	C	R	W	-
35	<i>C4 brightness threshold</i>	<i>Request</i>	2 byte 9,004	C	R	-	T
		<i>set/query</i>	1 bit 1,001	C	R	W	T
36	<i>C5 1 switching channel</i>	<i>Switching</i>	1 bit 1,001	C	R	-	T
		<i>Value</i>	1 byte 5,010	C	R	-	T
		<i>priority</i>	2 bit 2,001	C	R	-	T
37	<i>C5 2 switching channel</i>	<i>Switching</i>	1 bit 1,001	C	R	-	T
		<i>Value</i>	1 byte 5,010	C	R	-	T
		<i>priority</i>	2 bit 2,001	C	R	-	T
38	<i>C5 lock</i>	<i>Disable = 1</i>	1 bit 1,001	C	R	W	-
		<i>Disable = 0</i>	1 bit 1,001	C	R	W	-
39	<i>C5 brightness threshold</i>	<i>set/query</i>	2 byte 9,004	C	R	W	T
		<i>Request</i>	1 bit 1,001	C	R	-	T
40	<i>C6 1 switching channel</i>	<i>Switching</i>	1 bit 1,001	C	R	-	T
		<i>Value</i>	1 byte 5,010	C	R	-	T
		<i>priority</i>	2 bit 2,001	C	R	-	T

Continuation:

No.	Object name	Function	Type DPT	Flags			
				C	R	W	T
41	C6 2 switching channel	Switching	1 bit 1,001	C	R	-	T
		Value	1 byte 5,010	C	R	-	T
		priority	2 bit 2,001	C	R	-	T
42	C6 lock	Disable = 1	1 bit 1,001	C	R	W	-
		Disable = 0	1 bit 1,001	C	R	W	-
43	C6 brightness threshold	set/query	2 byte 9,004	C	R	W	T
		Request	1 bit 1,001	C	R	-	T
44	C7 1 switching channel	Switching	1 bit 1,001	C	R	-	T
		Value	1 byte 5,010	C	R	-	T
		priority	2 bit 2,001	C	R	-	T
45	C7 2 switching channel	Switching	1 bit 1,001	C	R	-	T
		Value	1 byte 5,010	C	R	-	T
		priority	2 bit 2,001	C	R	-	T
46	C7 lock	Disable = 1	1 bit 1,001	C	R	W	-
		Disable = 0	1 bit 1,001	C	R	W	-
47	C7 brightness threshold	set/query	2 byte 9,004	C	R	W	T
		Request	1 bit 1,001	C	R	-	T
48	C8 1 switching channel	Switching	1 bit 1,001	C	R	-	T
		Value	1 byte 5,010	C	R	-	T
		priority	2 bit 2,001	C	R	-	T

Continuation:

No.	Object name	Function	Type DPT	Flags			
				C	R	W	T
49	<i>C8 2 switching channel</i>	<i>Switching</i>	1 bit 1,001	C	R	-	T
		<i>Value</i>	1 byte 5,010	C	R	-	T
		<i>priority</i>	2 bit 2,001	C	R	-	T
50	<i>C8 lock</i>	<i>Disable = 1</i>	1 bit 1,001	C	R	W	-
		<i>Disable = 0</i>	1 bit 1,001	C	R	W	-
51	<i>C8 brightness threshold</i>	<i>set/query</i>	2 byte 9,004	C	R	W	T
		<i>Request</i>	1 bit 1,001	C	R	-	T
52	<i>C9 1 switching channel</i>	<i>Switching</i>	1 bit 1,001	C	R	-	T
		<i>Value</i>	1 byte 5,010	C	R	-	T
		<i>priority</i>	2 bit 2,001	C	R	-	T
53	<i>C9 2 switching channel</i>	<i>Switching</i>	1 bit 1,001	C	R	-	T
		<i>Value</i>	1 byte 5,010	C	R	-	T
		<i>priority</i>	2 bit 2,001	C	R	-	T
54	<i>C9 lock</i>	<i>Disable = 0</i>	1 bit 1,001	C	R	W	-
		<i>Disable = 1</i>	1 bit 1,001	C	R	W	-
55	<i>C9 brightness threshold</i>	<i>set/query</i>	2 byte 9,004	C	R	W	T
		<i>Request</i>	1 bit 1,001	C	R	-	T
56	<i>C10 1 switching channel</i>	<i>Switching</i>	1 bit 1,001	C	R	-	T
		<i>Value</i>	1 byte 5,010	C	R	-	T
		<i>priority</i>	2 bit 2,001	C	R	-	T

Continuation:

No.	Object name	Function	Type DPT	Flags			
				C	R	W	T
57	<i>C10 2 switching channel</i>	<i>Switching</i>	1 bit 1,001	C	R	-	T
		<i>Value</i>	1 byte 5,010	C	R	-	T
		<i>priority</i>	2 bit 2,001	C	R	-	T
58	<i>C10 lock</i>	<i>Disable = 0</i>	1 bit 1,001	C	R	W	-
		<i>Disable = 1</i>	1 bit 1,001	C	R	W	-
59	<i>C10 brightness threshold</i>	<i>Request</i>	2 byte 9,004	C	R	-	T
		<i>set/query</i>	1 bit 1,001	C	R	W	T
60	<i>C11 threshold switch input</i>	<i>0..65535</i>	2 byte 7,001	C	R	W	-
		<i>EIS 5</i>	2 byte 9.*	C	R	W	-
		<i>Percent</i>	1 byte 5,001	C	R	W	-
		<i>0..255</i>	1 byte 5,010	C	R	W	-
61	<i>C11 lock</i>	<i>Disable = 0</i>	1 bit 1,001	C	R	W	-
		<i>Disable = 1</i>	1 bit 1,001	C	R	W	-
62	<i>C11.1 threshold switch input</i>	<i>Switching</i>	1 bit 1,001	C	R	-	T
		<i>Value</i>	1 byte 5,010	C	R	-	T
		<i>priority</i>	2 bit 2,001	C	R	-	T
63	<i>C11.2 threshold switch input</i>	<i>Switching</i>	1 bit 1,001	C	R	-	T
		<i>Value</i>	1 byte 5,010	C	R	-	T
		<i>priority</i>	2 bit 2,001	C	R	-	T

Continuation:

No.	Object name	Function	Type DPT	Flags			
				C	R	W	T
64	<i>C12 threshold switch input</i>	<i>0..65535</i>	2 byte 7,001	C	R	W	-
		<i>EIS 5</i>	2 byte 9.*	C	R	W	-
		<i>Percent</i>	1 byte 5,001	C	R	W	-
		<i>0..255</i>	1 byte 5,010	C	R	W	-
65	<i>C12 lock</i>	<i>Disable = 0</i>	1 bit 1,001	C	R	W	-
		<i>Disable = 1</i>	1 bit 1,001	C	R	W	-
66	<i>C12.1 threshold switch input</i>	<i>Switching</i>	1 bit 1.001	C	R	-	T
		<i>Value</i>	1 byte 5,010	C	R	-	T
		<i>priority</i>	2 bit 2,001	C	R	-	T
67	<i>C12.2 threshold switch input</i>	<i>Switching</i>	1 bit 1.001	C	R	-	T
		<i>Value</i>	1 byte 5,010	C	R	-	T
		<i>priority</i>	2 bit 2,001	C	R	-	T
68	<i>C13 threshold switch input</i>	<i>0..65535</i>	2 byte 7,001	C	R	W	-
		<i>EIS 5</i>	2 byte 9.*	C	R	W	-
		<i>Percent</i>	1 byte 5,001	C	R	W	-
		<i>0..255</i>	1 byte 5,010	C	R	W	-
69	<i>C13 lock</i>	<i>Disable = 0</i>	1 bit 1,001	C	R	W	-
		<i>Disable = 1</i>	1 bit 1,001	C	R	W	-
70	<i>C13.1 threshold switch input</i>	<i>Switching</i>	1 bit 1.001	C	R	-	T
		<i>Value</i>	1 byte 5,010	C	R	-	T
		<i>priority</i>	2 bit 2,001	C	R	-	T

Continuation:

No.	Object name	Function	Type DPT	Flags			
				C	R	W	T
71	<i>C13.2 threshold switch input</i>	<i>Switching</i>	1 bit 1,001	C	R	-	T
		<i>Value</i>	1 byte 5,010	C	R	-	T
		<i>priority</i>	2 bit 2,001	C	R	-	T
72	<i>C14 threshold switch input</i>	<i>0..65535</i>	2 byte 7,001	C	R	W	-
		<i>EIS 5</i>	2 byte 9.*	C	R	W	-
		<i>Percent</i>	1 byte 5,001	C	R	W	-
		<i>0..255</i>	1 byte 5,010	C	R	W	-
73	<i>C14 lock</i>	<i>Disable = 0</i>	1 bit 1,001	C	R	W	-
		<i>Disable = 1</i>	1 bit 1,001	C	R	W	-
74	<i>C14.1 threshold switch input</i>	<i>Switching</i>	1 bit 1,001	C	R	-	T
		<i>Value</i>	1 byte 5,010	C	R	-	T
		<i>priority</i>	2 bit 2,001	C	R	-	T
75	<i>C14.2 threshold switch input</i>	<i>Switching</i>	1 bit 1,001	C	R	-	T
		<i>Value</i>	1 byte 5,010	C	R	-	T
		<i>priority</i>	2 bit 2,001	C	R	-	T
76	<i>C15 Logic module</i>	<i>Logic input 1 in AND/OR/XOR gate</i>	1 bit 1,001	C	R	W	-
77		<i>Logic input 2 in AND/OR/XOR gate</i>	1 bit 1,001	C	R	W	-
78		<i>Logic input 3 in AND/OR gate</i>	1 bit 1,001	C	R	W	-
79		<i>Logic input 4 in AND/OR gate</i>	1 bit 1,001	C	R	W	-
80	<i>C15 Logic module</i>	<i>Disable = 0</i>	1 bit 1,001	C	R	W	-
		<i>Disable = 1</i>	1 bit 1,001	C	R	W	-

Continuation:

No.	Object name	Function	Type DPT	Flags			
				C	R	W	T
81	<i>C15.1 Logic module</i>	<i>Switching</i>	1 bit 1,001	C	R	-	T
		<i>Value</i>	1 byte 5,010	C	R	-	T
		<i>priority</i>	2 bit 2,001	C	R	-	T
82	<i>C15.2 Logic module</i>	<i>Switching</i>	1 bit 1,001	C	R	-	T
		<i>Value</i>	1 byte 5,010	C	R	-	T
		<i>priority</i>	2 bit 2,001	C	R	-	T
83	<i>C16 Logic module</i>	<i>Logic input 1 in AND/OR/XOR gate</i>	1 bit 1,001	C	R	W	-
84		<i>Logic input 2 in AND/OR/XOR gate</i>	1 bit 1,001	C	R	W	-
85		<i>Logic input 3 in AND/OR gate</i>	1 bit 1,001	C	R	W	-
86		<i>Logic input 4 in AND/OR gate</i>	1 bit 1,001	C	R	W	-
87	<i>C16 Logic module</i>	<i>Disable = 0</i>	1 bit 1,001	C	R	W	-
		<i>Disable = 1</i>	1 bit 1,001	C	R	W	-
88	<i>C16.1 Logic module</i>	<i>Switching</i>	1 bit 1,001	C	R	-	T
		<i>Value</i>	1 byte 5,010	C	R	-	T
		<i>priority</i>	2 bit 2,001	C	R	-	T
89	<i>C16.2 Logic module</i>	<i>Switching</i>	1 bit 1,001	C	R	-	T
		<i>Value</i>	1 byte 5,010	C	R	-	T
		<i>priority</i>	2 bit 2,001	C	R	-	T
90	<i>C17 Logic module</i>	<i>Logic input 1 in AND/OR/XOR gate</i>	1 bit 1,001	C	R	W	-
91		<i>Logic input 2 in AND/OR/XOR gate</i>	1 bit 1,001	C	R	W	-
92		<i>Logic input 3 in AND/OR gate</i>	1 bit 1,001	C	R	W	-
93		<i>Logic input 4 in AND/OR gate</i>	1 bit 1,001	C	R	W	-

Continuation:

No.	Object name	Function	Type DPT	Flags			
				C	R	W	T
94	<i>C17 Logic module</i>	<i>Disable = 1</i>	1 bit 1,001	C	R	W	-
		<i>Disable = 0</i>	1 bit 1,001	C	R	W	-
95	<i>C17.1 Logic module</i>	<i>Switching</i>	1 bit 1.001	C	R	-	T
		<i>Value</i>	1 byte 5,010	C	R	-	T
		<i>priority</i>	2 bit 2,001	C	R	-	T
96	<i>C17.2 Logic module</i>	<i>Switching</i>	1 bit 1.001	C	R	-	T
		<i>Value</i>	1 byte 5,010	C	R	-	T
		<i>priority</i>	2 bit 2,001	C	R	-	T
97	<i>C18 Logic module</i>	<i>Logic input 1 in AND/OR/XOR gate</i>	1 bit 1,001	C	R	W	-
98		<i>Logic input 2 in AND/OR/XOR gate</i>	1 bit 1,001	C	R	W	-
99		<i>Logic input 3 in AND/OR gate</i>	1 bit 1,001	C	R	W	-
100		<i>Logic input 4 in AND/OR gate</i>	1 bit 1,001	C	R	W	-
101	<i>C18 Logic module</i>	<i>Disable = 0</i>	1 bit 1,001	C	R	W	-
		<i>Disable = 1</i>	1 bit 1,001	C	R	W	-
102	<i>C18.1 Logic module</i>	<i>Switching</i>	1 bit 1.001	C	R	-	T
		<i>Value</i>	1 byte 5,010	C	R	-	T
		<i>priority</i>	2 bit 2,001	C	R	-	T
103	<i>C18.2 Logic module</i>	<i>Switching</i>	1 bit 1.001	C	R	-	T
		<i>Value</i>	1 byte 5,010	C	R	-	T
		<i>priority</i>	2 bit 2,001	C	R	-	T

Continuation:

No.	Object name	Function	Type DPT	Flags			
				C	R	W	T
104	C19 Logic module	Logic input 1 in AND/OR/XOR gate	1 bit 1,001	C	R	W	-
105		Logic input 2 in AND/OR/XOR gate	1 bit 1,001	C	R	W	-
106		Logic input 3 in AND/OR gate	1 bit 1,001	C	R	W	-
107		Logic input 4 in AND/OR gate	1 bit 1,001	C	R	W	-
108	C19 Logic module	Disable = 1	1 bit 1,001	C	R	W	-
		Disable = 0	1 bit 1,001	C	R	W	-
109	C19.1 Logic module	Switching	1 bit 1,001	C	R	-	T
		Value	1 byte 5,010	C	R	-	T
		priority	2 bit 2,001	C	R	-	T
110	C19.2 Logic module	Switching	1 bit 1,001	C	R	-	T
		Value	1 byte 5,010	C	R	-	T
		priority	2 bit 2,001	C	R	-	T
111	C20 Logic module	Logic input 1 in AND/OR/XOR gate	1 bit 1,001	C	R	W	-
112		Logic input 2 in AND/OR/XOR gate	1 bit 1,001	C	R	W	-
113		Logic input 3 in AND/OR gate	1 bit 1,001	C	R	W	-
114		Logic input 4 in AND/OR gate	1 bit 1,001	C	R	W	-
115	C20 Logic module	Disable = 0	1 bit 1,001	C	R	W	-
		Disable = 1	1 bit 1,001	C	R	W	-

Continuation:

No.	Object name	Function	Type DPT	Flags			
				C	R	W	T
116	<i>C20.1 Logic module</i>	<i>Switching</i>	1 bit 1,001	C	R	-	T
		<i>Value</i>	1 byte 5,010	C	R	-	T
		<i>priority</i>	2 bit 2,001	C	R	-	T
117	<i>C20.2 Logic module</i>	<i>Switching</i>	1 bit 1,001	C	R	-	T
		<i>Value</i>	1 byte 5,010	C	R	-	T
		<i>priority</i>	2 bit 2,001	C	R	-	T

3.2.1 Description of objects

3.2.1.1 Physical values

- **Object 0** "*Brightness sensor 1*"

Sends the current brightness value at the first brightness sensor (data bus).

- **Object 1** "*Brightness sensor 2*"

Sends the current brightness value at the second brightness sensor (data bus).

- **Object 2** "*Brightness sensor 3*"

Sends the current brightness value at the third brightness sensor (data bus).

- **Object 3** "*Maximum brightness value*"

Reports the highest measured value from objects 0, 1 and 2.
Received external brightness values are not considered.

- **Objects 4-16**

Not used.

- **Object 17** "*Brightness sensors status*"

0 = All sensors OK

1 = at least 1 sensor defective.

- **Object 18.19**

Not used.

3.2.1.2 Switching channels C1..C10

- **Object 20** "*C1.1 switching channel*"

This is the first output object of a switching channel.
The function of the object depends upon the selected telegram type (see *Objects* parameter page, *telegram type C1.1* parameter).

Table 3

Telegram type	format	Sent telegrams								
Switching	DPT 1.001 (On/Off)	On / Off								
priority	DPT 2.001 (priority control)	2-bit telegram <table border="1" data-bbox="555 763 1177 920"> <thead> <tr> <th><i>Function</i></th> <th><i>value</i></th> </tr> </thead> <tbody> <tr> <td>no priority (no control)</td> <td>0</td> </tr> <tr> <td>Priority OFF (control: disable, off)</td> <td>2</td> </tr> <tr> <td>Priority ON (control: enable, on)</td> <td>3</td> </tr> </tbody> </table>	<i>Function</i>	<i>value</i>	no priority (no control)	0	Priority OFF (control: disable, off)	2	Priority ON (control: enable, on)	3
<i>Function</i>	<i>value</i>									
no priority (no control)	0									
Priority OFF (control: disable, off)	2									
Priority ON (control: enable, on)	3									
value	DPT 5.010	Value between 0 and 255								

- **Object 21** "*C1.2 switching*"

This is the second output object of a switching channel.
The function of the object depends upon the selected telegram type (see *Objects* parameter page, *telegram type C1.2* parameter).

The telegram type can be parameterized independently of the first output object.
The same setting options are available for this purpose as for the first output object (see table above for object 20)

The cycle time and the disabling behaviour are apply to both objects (objects 20+21).

- **Object 22** "*Disable C1*"

Only available if the disable function is activated.

The behaviour when setting/cancelling the block and the acting direction can be selected on the *objects* parameter page.

- **Object 23** "*C1 brightness threshold*"

This object can be used to call up the channel's configured brightness threshold. When the value via object parameter is overwritten to yes, the threshold can be changed via bus telegram.

Table 4: Value range.

Received value	Effect
0 lx	Threshold is reset to the configured value in the ETS.
> 0 lx .. < 3 lx	Value is ignored
3 – 90,000 lx	Value is accepted as new brightness threshold.
> 90,000 lx	Brightness threshold value is set to 90,000 lx.

- **Objects 24..59**

Objects 24 to 59 are for the switching channels C2..C10 and are identical in their function to the objects on channel C1.

3.2.1.3 Threshold switches C11..C14

- **Object 60** "*C11 threshold switch input*"

Channel input object, this object activates the set channel function..

<i>Type of threshold value object</i>	Activation of channel function via
<i>object type: Per cent (DPT 5.001)</i>	Exceeding per cent value
<i>Object type: Counter value 0..255 (DPT 5.010)</i>	Any value in given numerical range
<i>object type: Counter value 0..65535 (DPT 7.001)</i>	
<i>Object type: EIS5 e.g. CO2, brightness (DPT 9.xxx)</i>	2 byte floating-point number

- **Object 61** "*Disable C11*"

Channel disable object.

Only visible if the disable function is activated.

The acting direction (disable with 0 or 1) can be set via parameter.

- **Object 62** "*C11.1 threshold value switch, switch/Value/priority*"

This is the first output object of the threshold switch.

The function of the object depends upon the selected telegram type (see *Objects* parameter page, *telegram type C11.1* parameter).

Table 5

Telegram type	format	Sent telegrams								
Switching	DPT 1.001 (On/Off)	On / Off								
priority	DPT 2.001 (priority control)	2-bit telegram <table border="1" data-bbox="555 1547 1177 1704"> <tr> <td><i>Function</i></td> <td><i>value</i></td> </tr> <tr> <td>no priority (no control)</td> <td>0</td> </tr> <tr> <td>Priority OFF (control: disable, off)</td> <td>2</td> </tr> <tr> <td>Priority ON (control: enable, on)</td> <td>3</td> </tr> </table>	<i>Function</i>	<i>value</i>	no priority (no control)	0	Priority OFF (control: disable, off)	2	Priority ON (control: enable, on)	3
<i>Function</i>	<i>value</i>									
no priority (no control)	0									
Priority OFF (control: disable, off)	2									
Priority ON (control: enable, on)	3									
value	DPT 5.010	Value between 0 and 255								

- **Object 63** "*C11.2 threshold value switch, switch/Value/priority*"

This is the second output object of the threshold switch.

The function of the object depends upon the selected telegram type (see *Objects* parameter page, *telegram type C11.2* parameter).

The telegram type can be parameterized independently of the first output object.

The same setting options are available for this purpose as for the first output object (see table above for object 86)

The cycle time and the disabling behaviour are apply to both objects (objects 86+87).

- **Objects 64..75**

Objects 64 to 75 are for the switching channels C12/C14 and are identical in their function to the objects on channel C11.

3.2.1.4 Logic modules C15..C20

- **Object 76** "*C15 logic module, logic input 1 in UND/OR/XOR gate*"

First input object of the logic module.

- **Object 77** "*C15 logic module, logic input 2 in UND/OR/XOR gate*"

Second input object of the logic module.

- **Object 78** "*C15 logic module, logic input 3 in AND/OR gate*"

Third input object of the logic module.

Not used with XOR link.

- **Object 79** "*C15 logic module, logic input 4 in AND/OR gate*"

Fourth input object of the logic module.

Not used with XOR link.

- **Object 80** "*C15 logic module, disable*"

Channel disable object.

Only visible if the disable function is activated.

The acting direction (disable with 0 or 1) can be set via parameter.

- **Object 81** "*C15.1 logic module, switch/Value/priority*"

This is the first output object of the logic module.
The function of the object depends upon the selected telegram type (see *Objects* parameter page, *telegram type C15.1* parameter).

Table 6

Telegram type	format	Sent telegrams	
Switching	DPT 1.001 (On/Off)	On / Off	
priority	DPT 2.001 (priority control)	2-bit telegram	
		<i>Function</i>	<i>value</i>
		no priority (no control)	0
		Priority OFF (control: disable, off)	2
		Priority ON (control: enable, on)	3
value	DPT 5.010	Value between 0 and 255	

- **Object 82** "*C15.2 logic module, switch/Value/priority*"

This is the second output object of the logic module.
The function of the object depends upon the selected telegram type (see *Objects* parameter page, *telegram type C15.2* parameter).

The telegram type can be parameterized independently of the first output object.
The same setting options are available for this purpose as for the first output object (see table above for object 105)

The cycle time and the disabling behaviour are apply to both objects (objects 86+87).

- **Objects 83..117**

Objects 83 to 117 are for the logic modules C16/C20 and are identical in their function to the objects on channel C15.

3.3 Parameter

3.3.1 Parameter pages

Table 7

Function	Description
General	Activation of the required channel types. Language setting, backlighting, PIN code.
Measured values	Settings for sending brightness and sensor adjustment.
Switching channel C1: Function .. Switching channel C10: Function	Basic settings, delays etc.
objects*	Telegram type, switching and disable response etc.
Threshold channel C11: Function .. Threshold channel C14: Function	Type of threshold value object, delays etc.
objects*	Telegram type, switching and disable response etc.
Logic channel C15: Function .. Logic channel C20: Function	Number of inputs, links etc.
objects*	Telegram type, switching and disable response etc.

* Own parameter page for each channel.

3.3.2 Parameter description

Settings that lead to the display of other pages or functions are identified by ...

Example: *yes/no*

3.3.2.1 The "General" parameter page

<i>Designation</i>	<i>Values</i>	<i>Description</i>
<i>Activate switching channel C1</i>	<i>No</i> <i>Yes.</i>	The switching channels can issue telegrams independent of brightness.
<i>Activate switching channel C2</i>	<i>No</i> <i>Yes.</i>	
<i>Activate switching channel C3</i>	<i>No</i> <i>Yes.</i>	
<i>Activate switching channel C4</i>	<i>No</i> <i>Yes.</i>	
<i>Activate switching channel C5</i>	<i>No</i> <i>Yes.</i>	
<i>Activate switching channel C6</i>	<i>No</i> <i>Yes.</i>	
<i>Activate switching channel C7</i>	<i>No</i> <i>Yes.</i>	
<i>Activate switching channel C8</i>	<i>No</i> <i>Yes.</i>	
<i>Activate switching channel C9</i>	<i>No</i> <i>Yes.</i>	
<i>Activate switching channel C10</i>	<i>No</i> <i>Yes.</i>	
<i>Activating threshold channel C11</i>	<i>No</i> <i>Yes.</i>	Switch threshold value channels based on received bus telegram depending whether a value is exceeded or not achieved.
<i>Activating threshold channel C12</i>	<i>No</i> <i>Yes.</i>	
<i>Activating threshold channel C13</i>	<i>No</i> <i>Yes.</i>	
<i>Activating threshold channel C14</i>	<i>No</i> <i>Yes.</i>	

Continuation:

<i>Designation</i>	<i>Values</i>	<i>Description</i>
<i>Activating logic channel C15</i>	<i>No</i> <i>Yes.</i>	Logic channels enable the linking of up to 4 input sizes.
<i>Activating logic channel C16</i>	<i>No</i> <i>Yes.</i>	These can be both specific logic input objects (max. 4) and the switching statuses of other channels (switching, threshold or logic channels).
<i>Activating logic channel C17</i>	<i>No</i> <i>Yes.</i>	
<i>Activating logic channel C18</i>	<i>No</i> <i>Yes.</i>	
<i>Activating logic channel C19</i>	<i>No</i> <i>Yes.</i>	
<i>Activating logic channel C20</i>	<i>No</i> <i>Yes.</i>	
<i>Language after download</i>	<i>German</i> <i>English</i> <i>French</i> <i>Italian</i> <i>Spanish</i> <i>Dutch</i> <i>Reserved for additional language</i> <i>7</i> <i>..</i> <i>Reserved for additional language</i> <i>15</i>	Language for displayed text info.
<i>Backlit display after download</i>	<i>Off</i> <i>On</i> <i>when operating</i> <i>unchanged: As set on device</i>	After download, the display backlighting... allow to switch on or off. switch on or leave on continuously. only switch on when the device is being used (automatic switch-off after approx. 1 minute). do not change
<i>Settings on device</i>	<i>enabled</i> <i>Released via PIN</i>	No PIN code: The device is always operable. The device can only be used after the input of a PIN code.
<i>PIN code 1000-9999</i>	<i>Manual input</i> <i>1000-9999</i> <i>Default value: 1234</i>	Enter desired PIN number here.

3.3.2.2 "Brightness measurement" parameter page"

Designation	Values	Description
Send brightness value on change	no of 20 %, at least but 1 lx of 30 %, at least but 1 lx of 50 %, at least but 1 lx of 10 %, at least but 1 lx	Only send cyclically (if enabled) Send if the value has changed by 10%, 20% etc. since it was last sent. However, if a change of 10% corresponds to a brightness change < 1 lx, then the value is not sent until the change is at least >1 lx.
Send brightness value and sensor status cyclically	do not send cyclically every 1 min every 2 min every 3 min every 5 min every 10 min every 15 min every 20 min every 30 min every 45 min every 60 min	how often should the current brightness value and the current status of the brightness sensors be sent?
Name for brightness sensor 1 (appears in display)	Text input (max. 16 characters)	Free choice of description for the sensor e.g. "south side". Is displayed on device as sensor name.
Brightness adjustment sensor 1 [%]	-30..30 (Default = 0)	Individual adjustment value for the brightness measurement at sensor 1, if the transmitted value deviates from the actual ambient brightness. Example: Brightness = 10,000 lx Transmitted = 11,000 lx Adjustment value = -10 %
Brightness adjustment sensor 2 [%] if available	-30..30 (Default = 0)	Individual adjustment value in per cent, for the brightness measurement at sensor 2
Name for brightness sensor 2 (appears in display)	Text input (max. 16 characters)	Free choice of description for the sensor e.g. "west side". Is displayed on device as sensor name.
Brightness adjustment sensor 3 [%] if available	-30..30 (Default = 0)	Individual adjustment value in per cent, for the brightness measurement at sensor 3
Name for brightness sensor 3 (appears in display)	Text input (max. 16 characters)	Free choice of description for the sensor e.g. "east side". Is displayed on device as sensor name.

3.3.2.3 Parameter pages: "Switching channel C1..C10: Function"

The switching channels C1..C10 switch independent of measured brightness.

Each switching channel has a disable object and an object for setting the brightness value.

The switching channels are activated on the general parameter page.

Different parameters are available according to the set functions.

Table 8

Designation	Values	Description
<i>Channel name</i>	Manual input (max. 14 characters)	Enter name that is to appear on the device display for thus channel
<i>Brightness</i>	<i>Below 3 lx .. below 90,000 lx</i> (in 70 increments, Default = below 20 lx)	The channel condition is fulfilled when the value is below the set threshold.
	<i>Over 3 lx .. over 90,000 lx</i> (in 70 increments)	The channel condition is fulfilled when the value is above the set threshold.
<i>Source</i>	<i>Sensor 1</i> <i>Sensor 2,</i> <i>Sensor 3, if available</i>	Which of the 3 installed brightness sensors should be used?
	<i>maximum value of the 3 sensors</i>	The values of the 3 sensors are compared with each other and only the highest value is taken into account.
<i>Light hysteresis</i>	<i>20 % at least but 1 lx</i> <i>30 % at least but 1 lx</i> <i>50 % at least but 1 lx</i>	The hysteresis prevents frequent switching after small changes in brightness. Depending on the selected condition, it can be either negative or positive. Example with 20% hysteresis: Condition: "OVER 4,500 lux" = satisfied from 4,500 lx and no longer satisfied at 4,500 lx - 20% Condition: "UNDER 4500 lux" = satisfied below 4500 lx and no longer satisfied at 4500 lx + 20%

Continuation:

Designation	Values	Description
<i>Delay when brightness increases*</i>	<i>none</i> <i>5 s, 10 s, 20 s, 30 s, 1 min, 2 min, 3 min, 5 min, 10 min, 15 min, 20 min</i>	Response time when it gets lighter and the selected threshold is passed as a result. This setting prevents conflicting telegrams from being sent in response to temporary fluctuations in brightness
<i>Delay when brightness decreases*</i>	<i>none</i> <i>5 s, 10 s, 20 s, 30 s, 1 min, 2 min, 3 min, 5 min, 10 min, 15 min, 20 min</i>	Response time when it gets darker and the selected threshold is passed as a result. This setting prevents conflicting telegrams from being sent in response to temporary fluctuations in brightness
<i>Value can be overwritten via object</i>	<i>Yes</i> <i>no</i>	Should it be possible to change the configured brightness threshold value at any time via bus telegrams?
<i>Overwrite value at download</i>	<i>Yes</i> <i>no</i>	With an ETS download, the brightness threshold currently stored in the device with its delay values is deleted and overwritten with the value set in the ETS The brightness and delay values changed on the device or via an object are write-protected . With downloads, the brightness values and delay values are not downloaded . The values currently stored in the device are retained. Exception: Even if <i>no</i> is selected, all ETS parameter values will be downloaded on first use (i.e. when the device memory is empty).

* **Important:** Manual changes to the delay values on the device will only be accepted after the next status change.

3.3.2.4 Parameter pages "Objects"

All universal, threshold and logic channels have this type of parameter page. The reaction to fulfilling or not fulfilling the link is configured here..

Table 9

Designation	Values	Description								
<i>Telegram type C1.1</i>	<p>Switching command</p> <p><i>Priority</i></p> <p><i>value</i></p>	<p>1 bit ON/OFF</p> <p>2-bit</p> <table border="1"> <thead> <tr> <th>Function</th> <th>value</th> </tr> </thead> <tbody> <tr> <td>Priority inactive (no control)</td> <td>0 (00_{bin})</td> </tr> <tr> <td>Priority ON (control: enable, on)</td> <td>3 (11_{bin})</td> </tr> <tr> <td>Priority OFF (control: disable, off)</td> <td>2 (10_{bin})</td> </tr> </tbody> </table> <p>1-byte 0 ... 255</p>	Function	value	Priority inactive (no control)	0 (00 _{bin})	Priority ON (control: enable, on)	3 (11 _{bin})	Priority OFF (control: disable, off)	2 (10 _{bin})
Function	value									
Priority inactive (no control)	0 (00 _{bin})									
Priority ON (control: enable, on)	3 (11 _{bin})									
Priority OFF (control: disable, off)	2 (10 _{bin})									
<i>If the condition is met</i>	<p><i>no telegram</i></p> <p>send following telegram once</p> <p><i>send cyclically</i></p>	Send response if channel condition is fulfilled.								
<i>Telegram</i>	<p>ON</p> <p>OFF</p> <p><i>no priority</i></p> <p>priority, ON (down)</p> <p>priority, OFF (up)</p> <p>Telegram 0 ... 255</p>	<p>Type of telegram for the first output object on the channel with fulfilled condition.</p> <p>For telegram type Switching command.</p> <p>For telegram type Priority.</p> <p>For telegram type Value</p>								
<i>If the condition is not met</i>	<p><i>no telegram</i></p> <p>send following telegram once</p> <p><i>send cyclically</i></p>	Send response if channel condition is unfulfilled.								
<i>Telegram</i>	<p>ON</p> <p>OFF</p> <p><i>no priority</i></p> <p>priority, ON (down)</p> <p>priority, OFF (up)</p> <p>Telegram 0 .. 255</p>	<p>Type of telegram for the first output object on the channel with unfulfilled condition.</p> <p>For telegram type Switching command.</p> <p>For telegram type Priority.</p> <p>For telegram type Value</p>								

Continuation:

Designation	Values	Description								
<i>Should a second telegram be sent?</i>	<i>Yes</i> <i>no</i>	If yes is selected, further parameters and a second transmission object appear. It can be used to send 2 different telegrams at the same time on the same channel. The cycle time and the disabling behaviour apply to both objects.								
<i>Telegram type C1.2</i>	Switching command <i>Priority</i> <i>value</i>	Second output object on channel 1 bit ON/OFF 2-bit <table border="1"> <thead> <tr> <th>Function</th> <th>value</th> </tr> </thead> <tbody> <tr> <td>Priority inactive (no control)</td> <td>0 (00_{bin})</td> </tr> <tr> <td>Priority ON (control: enable, on)</td> <td>3 (11_{bin})</td> </tr> <tr> <td>Priority OFF (control: disable, off)</td> <td>2 (10_{bin})</td> </tr> </tbody> </table> 1-byte 0 ... 255	Function	value	Priority inactive (no control)	0 (00 _{bin})	Priority ON (control: enable, on)	3 (11 _{bin})	Priority OFF (control: disable, off)	2 (10 _{bin})
Function	value									
Priority inactive (no control)	0 (00 _{bin})									
Priority ON (control: enable, on)	3 (11 _{bin})									
Priority OFF (control: disable, off)	2 (10 _{bin})									
<i>If the condition is met</i>	<i>no telegram</i> send following telegram once <i>send cyclically</i>	Send response if channel condition is fulfilled.								
<i>Telegram</i>	ON OFF <i>no priority</i> priority, ON (down) <i>priority, OFF (up)</i> Telegram 0 ... 255	Type of telegram for the second output object on the channel with fulfilled condition. For telegram type Switching command. For telegram type Priority. For telegram type Value								
<i>If the condition is not met</i>	<i>no telegram</i> send following telegram once <i>send cyclically</i>	Send response if channel condition is unfulfilled.								
<i>Telegram</i>	ON OFF <i>no priority</i> priority, ON (down) priority, OFF (up) Telegram 0 .. 255	Type of telegram for the second output object on the channel with unfulfilled condition. For telegram type Switching command. For telegram type Priority. For telegram type Value								

Continuation:

Designation	Values	Description
<i>Activate lock function</i>	<i>Yes</i>	Insert disable parameter and disable object.
	<i>no</i>	No disable function
<i>Response when setting disable</i>	<i>do not send</i>	No telegrams as long as the disable object is set.
	<i>as with unfulfilled condition</i>	Same reaction set as in parameter <i>If the conditioned has not been fulfilled</i> (see above).
	<i>as with fulfilled condition</i>	Same response as set with the parameter <i>If all conditions have been fulfilled</i> (see above).
<i>Behaviour when cancelling the disable function</i>	<i>do not send</i>	Not automatically resent when the disable function is cancelled
	<i>update channel</i>	The current channel status is sent immediately as soon as the disable function is cancelled.
<i>Cycle time (if used)</i>	<i>do not send cyclically</i> <i>every 1 min</i> <i>every 2 min</i> <i>every 3 min</i> <i>every 5 min</i> <i>every 10 min</i> <i>every 15 min</i> <i>every 20 min</i> <i>every 30 min</i> <i>every 45 min</i> <i>every 60 min</i>	How often should the telegrams for CX.1 and CX.2 be sent?
<i>Telegram with recognised sensor error</i>	<i>Do not send anymore</i> <i>as with unfulfilled condition as</i> <i>with fulfilled condition</i>	This parameter takes effect if the brightness sensor (used by channel) reports an error.

3.3.2.5 Parameter pages "*Threshold channel C11..C14*"

The threshold channel block forms a separate unit that is completely independent of the brightness measurement.

Principle:

A value is received from the bus and compared with the set threshold.

The condition is fulfilled if the value is higher than the set threshold.

In turn, not fulfilled if the value is below it.

The response of the output objects to fulfilling/not fulfilling the condition is set on the *Objects* parameter page.

The channel status (condition fulfilled/unfulfilled) for each threshold channel can also be configured as input value for logic channels (see below, The logic channels).

The switching channels are activated on the General parameter page.

Table 10

Designation	Values	Description
<i>Type of threshold value object</i>	object type: Per cent (DPT 5.001) <i>Object type: Counter value 0..255 (DPT 5.010)</i> <i>object type: Counter value 0..65535 (DPT 7.001)</i> <i>Object type: EIS5 e.g. CO2, brightness, etc. (DPT 9.xxx)</i>	Value type for threshold.
Parameter for <i>Percent</i> threshold object		
<i>Threshold value (in %)</i>	1..99 Default = 50	Desired threshold value as percentage.
<i>Hysteresis (as %)</i>	1..99 Default = 5	Prevents frequent switching after small changes in readings. The hysteresis is uniformly negative for all threshold types, e.g. threshold 50, hysteresis 5 means: Switch on at 50 a switch off at 50 – hysteresis = 45
Parameter for threshold value object <i>Counter value 0..255</i>		
<i>Threshold value</i>	1..254 Default = 127	Desired threshold value as 1 byte number from 1 to 254.
<i>Hysteresis</i>	1..254 Default = 5	The hysteresis prevents frequent switching after small changes in readings.

Continuation:

Designation	Values	Description
Parameter for threshold value object <i>Counter value 0..65535</i>		
<i>Threshold value</i>	<i>1..65534</i> Default = 1,000	Desired threshold value as 2 byte number from 1 to 65534.
<i>Hysteresis</i>	<i>1..65534</i> Default = 5	The hysteresis prevents frequent switching after small changes in readings.
Parameter for threshold value object <i>EIS5 (e.g. CO₂, brightness...)</i>		
<i>Threshold value format:</i> <i>(-000.00..9999)</i>	<i>-9999..99999</i> Default = 20.0	Desired threshold value as decimal number with prefix. Format: A maximum of 5 characters are permitted including decimal point and prefix. Examples with five characters: -9999 -9.99 10.35 100.6 99999 etc.
<i>Hysteresis format:</i> <i>0.00..9999</i>	<i>0.00..9999</i> Default = 1.0	The hysteresis prevents frequent switching after small changes in readings. Format: Max. 4 characters, positive numbers only. Examples: 0.01 99.9 9999
Common parameters		
<i>Delay with exceeding</i>	None , <i>5 s, 10 s, 20 s, 30 s, 1 min, 2 min, 3 min, 5 min, 10 min, 15 min, 20 min</i>	The channel sends immediately. The channel only sends after set delay is completed.
<i>Delay with falling below</i>	none , <i>5 s, 10 s, 20 s, 30 s, 1 min, 2 min, 3 min, 5 min, 10 min, 15 min, 20 min</i>	The channel sends immediately. The channel only sends after set delay is completed.

3.3.2.6 Parameter pages "Objects"

All universal, threshold and logic channels have this type of parameter page. The reaction to fulfilling or not fulfilling the link is configured here..

Table 11

Designation	Values	Description								
<i>Telegram type C11.1</i>	<p>Switching command</p> <p><i>Priority</i></p> <p><i>value</i></p>	<p>1 bit ON/OFF</p> <p>2-bit</p> <table border="1"> <thead> <tr> <th>Function</th> <th>value</th> </tr> </thead> <tbody> <tr> <td>Priority inactive (no control)</td> <td>0 (00_{bin})</td> </tr> <tr> <td>Priority ON (control: enable, on)</td> <td>3 (11_{bin})</td> </tr> <tr> <td>Priority OFF (control: disable, off)</td> <td>2 (10_{bin})</td> </tr> </tbody> </table> <p>1-byte 0 ... 255</p>	Function	value	Priority inactive (no control)	0 (00 _{bin})	Priority ON (control: enable, on)	3 (11 _{bin})	Priority OFF (control: disable, off)	2 (10 _{bin})
Function	value									
Priority inactive (no control)	0 (00 _{bin})									
Priority ON (control: enable, on)	3 (11 _{bin})									
Priority OFF (control: disable, off)	2 (10 _{bin})									
<i>When exceeding the threshold</i>	<p><i>no telegram</i></p> <p>send following telegram once</p> <p><i>send cyclically</i></p>	Send response if channel condition is fulfilled.								
<i>Telegram</i>	<p>ON</p> <p>OFF</p> <p><i>no priority</i></p> <p>priority, ON (down)</p> <p>priority, OFF (up)</p> <p>Telegram 0 ... 255</p>	<p>Type of telegram for the first output object on the channel with fulfilled condition.</p> <p>For telegram type Switching command.</p> <p>For telegram type Priority.</p> <p>For telegram type Value</p>								
<i>When below threshold</i>	<p><i>no telegram</i></p> <p>send following telegram once</p> <p><i>send cyclically</i></p>	Send response if channel condition is unfulfilled.								
<i>Telegram</i>	<p>ON</p> <p>OFF</p> <p><i>no priority</i></p> <p>priority, ON (down)</p> <p>priority, OFF (up)</p> <p>Telegram 0 .. 255</p>	<p>Type of telegram for the first output object on the channel with unfulfilled condition.</p> <p>For telegram type Switching command.</p> <p>For telegram type Priority.</p> <p>For telegram type Value</p>								

Continuation:

Designation	Values	Description								
<i>Should a second telegram be sent?</i>	<i>Yes</i> <i>no</i>	If yes is selected, further parameters and a second transmission object appear. It can be used to send 2 different telegrams at the same time on the same channel. The cycle time and the disabling behaviour apply to both objects.								
<i>Telegram type C11.2</i>	Switching command <i>Priority</i> <i>value</i>	Second output object on channel 1 bit ON/OFF 2-bit <table border="1" data-bbox="925 689 1311 936"> <thead> <tr> <th>Function</th> <th>value</th> </tr> </thead> <tbody> <tr> <td>Priority inactive (no control)</td> <td>0 (00_{bin})</td> </tr> <tr> <td>Priority ON (control: enable, on)</td> <td>3 (11_{bin})</td> </tr> <tr> <td>Priority OFF (control: disable, off)</td> <td>2 (10_{bin})</td> </tr> </tbody> </table> 1-byte 0 ... 255	Function	value	Priority inactive (no control)	0 (00 _{bin})	Priority ON (control: enable, on)	3 (11 _{bin})	Priority OFF (control: disable, off)	2 (10 _{bin})
Function	value									
Priority inactive (no control)	0 (00 _{bin})									
Priority ON (control: enable, on)	3 (11 _{bin})									
Priority OFF (control: disable, off)	2 (10 _{bin})									
<i>When exceeding the threshold</i>	<i>no telegram</i> send following telegram once <i>send cyclically</i>	Send response if channel condition is fulfilled.								
<i>Telegram</i>	<i>ON</i> <i>OFF</i> <i>no priority</i> priority, ON (down) <i>priority, OFF (up)</i> <i>Telegram 0 ... 255</i>	Type of telegram for the second output object on the channel with fulfilled condition. For telegram type Switching command. For telegram type Priority. For telegram type Value								
<i>When below threshold</i>	<i>no telegram</i> send following telegram once <i>send cyclically</i>	Send response if channel condition is unfulfilled.								
<i>Telegram</i>	<i>ON</i> <i>OFF</i> <i>no priority</i> priority, ON (down) priority, OFF (up) <i>Telegram 0 .. 255</i>	Type of telegram for the second output object on the channel with unfulfilled condition. For telegram type Switching command. For telegram type Priority. For telegram type Value								

Continuation:

Designation	Values	Description
<i>Activate lock function</i>	<i>Yes</i>	Insert disable parameter and disable object.
	<i>no</i>	No disable function
<i>Response when setting disable</i>	<i>do not send</i>	No telegrams as long as the disable object is set.
	<i>as with unfulfilled condition</i>	Same reaction set as with parameter <i>If below threshold</i> (see above).
	<i>as with fulfilled condition</i>	Same reaction set as with parameter <i>When exceeding threshold</i> (see above).
<i>Behaviour when cancelling the disable function</i>	<i>Do not send</i>	Not automatically resent when the disable function is cancelled
	<i>update channel</i>	The current channel status is sent immediately as soon as the disable function is cancelled.
<i>Cycle time (if used)</i>	<i>do not send cyclically</i> <i>every 1 min</i> <i>every 2 min</i> <i>every 3 min</i> <i>every 5 min</i> <i>every 10 min</i> <i>every 15 min</i> <i>every 20 min</i> <i>every 30 min</i> <i>every 45 min</i> <i>every 60 min</i>	How often should the telegrams for CX.1 and CX.2 be sent?

3.3.2.7 Parameter pages "*Logic channel C15..C20*"

The logic channel block forms a separate unit that is completely independent of the brightness measurement.

The logic channels can thus be used for a broad range of tasks in the KNX device.

Principle:

Up to four 1 bit input values can be logically linked to each other.

These input values can be:

- Logic inputs
- Status of switching channels (fulfilled/unfulfilled)
- Status of threshold channels (fulfilled/unfulfilled)
- Link result of other logic channels (a logic channel cannot be connected with itself)

The response of the output objects to fulfilling/not fulfilling the condition is set on the *Objects* parameter page.

The logic channels are activated on the general parameter page.

Table 12

Designation	Values	Description
<i>Type of link</i>	<i>AND</i>	Selection of logical link between 1-bit input values (see below) 2 to 4 inputs
	<i>OR</i>	
	<i>XOR</i>	2 inputs
<i>Use input 1</i>	<i>Yes</i>	Input is used
	<i>Yes, inverted</i>	Input appears inverted
<i>Use input 2</i>	<i>Yes</i>	See above, input 1
	<i>Yes, inverted</i>	
<i>Use input 3</i>	<i>No</i>	Input is hidden
	<i>Yes</i>	See above.
	<i>Yes, inverted</i>	
<i>Use input 4</i>	<i>No</i>	Input is hidden
	<i>Yes</i>	See above.
	<i>Yes, inverted</i>	

Continuation:

Designation	Values	Description
<i>Input value for input 1</i>	<p><i>Input object</i></p> <p><i>Condition C1 Condition C2</i> <i>Condition C3 Condition C4</i> <i>Condition C5 Condition C6</i> <i>Condition C7 Condition C8</i> <i>Condition C9 Condition C10</i></p> <p><i>Status threshold channel C11</i> <i>Status threshold channel C12</i> <i>Status threshold channel C13</i> <i>Status threshold channel C14</i></p> <p><i>Link result logic channel C15⁽¹⁾</i> <i>Link result logic channel C16⁽²⁾</i> <i>Link result logic channel C17⁽³⁾</i> <i>Link result logic channel C18⁽⁴⁾</i> <i>Link result logic channel C19⁽⁵⁾</i> <i>Link result logic channel C20⁽⁶⁾</i></p>	<p>First input object on channel (e.g. object 100 for C18)</p> <p>Status of switching channel (fulfilled/not fulfilled).</p> <p>Status of threshold channel (threshold exceeded/not exceeded).</p> <p>Link result of another logic channel (a logic channel cannot be connected with itself).</p>
<i>Input value for input 2</i>	<i>See above,</i> <i>Input value for input 1</i>	Second input object on channel See above.
<i>Input value for input 3</i>	<i>See above,</i> <i>Input value for input 1</i>	Third input object on channel See above.
<i>Input value for input 4</i>	<i>See above,</i> <i>Input value for input 1</i>	Fourth input object on channel See above.

⁽¹⁾ If C15 unavailable, ⁽²⁾ If C16 unavailable, ⁽³⁾ If C17 unavailable

⁽⁴⁾ If C18 unavailable, ⁽⁵⁾ If C19 unavailable, ⁽⁶⁾ If C20 unavailable

3.3.2.8 Parameter pages "Objects"

All universal, threshold and logic channels have this type of parameter page. The reaction to fulfilling or not fulfilling the link is configured here..

Table 13

Designation	Values	Description								
<i>Telegram type C15.1</i>	<p>Switching command</p> <p><i>Priority</i></p> <p><i>value</i></p>	<p>1 bit ON/OFF</p> <p>2-bit</p> <table border="1"> <thead> <tr> <th>Function</th> <th>value</th> </tr> </thead> <tbody> <tr> <td>Priority inactive (no control)</td> <td>0 (00_{bin})</td> </tr> <tr> <td>Priority ON (control: enable, on)</td> <td>3 (11_{bin})</td> </tr> <tr> <td>Priority OFF (control: disable, off)</td> <td>2 (10_{bin})</td> </tr> </tbody> </table> <p>1-byte 0 ... 255</p>	Function	value	Priority inactive (no control)	0 (00 _{bin})	Priority ON (control: enable, on)	3 (11 _{bin})	Priority OFF (control: disable, off)	2 (10 _{bin})
Function	value									
Priority inactive (no control)	0 (00 _{bin})									
Priority ON (control: enable, on)	3 (11 _{bin})									
Priority OFF (control: disable, off)	2 (10 _{bin})									
<i>If the condition is met</i>	<p><i>no telegram</i></p> <p>send following telegram once</p> <p><i>send cyclically</i></p>	Send response if channel condition is fulfilled, i.e. link result = 1.								
<i>Telegram</i>	<p>ON</p> <p>OFF</p> <p><i>no priority</i></p> <p>priority, ON (down)</p> <p><i>priority, OFF (up)</i></p> <p>Telegram 0 ... 255</p>	<p>Type of telegram for the first output object on the channel with fulfilled condition.</p> <p>For telegram type Switching command.</p> <p>For telegram type Priority.</p> <p>For telegram type Value</p>								
<i>If the condition is not met</i>	<p><i>no telegram</i></p> <p>send following telegram once</p> <p><i>send cyclically</i></p>	Send response if channel condition is not fulfilled, i.e. link result = 0.								
<i>Telegram</i>	<p>ON</p> <p>OFF</p> <p><i>no priority</i></p> <p>priority, ON (down)</p> <p>priority, OFF (up)</p> <p>Telegram 0 .. 255</p>	<p>Type of telegram for the first output object on the channel with unfulfilled condition.</p> <p>For telegram type Switching command.</p> <p>For telegram type Priority.</p> <p>For telegram type Value</p>								

Continuation:

Designation	Values	Description								
<i>Should a second telegram be sent?</i>	<i>Yes</i> <i>no</i>	If yes is selected, further parameters and a second transmission object appear. It can be used to send 2 different telegrams at the same time on the same channel. The cycle time and the disabling behaviour apply to both objects.								
<i>Telegram type C15.2</i>	Switching command <i>Priority</i> <i>value</i>	Second output object on channel 1 bit ON/OFF 2-bit <table border="1"> <thead> <tr> <th>Function</th> <th>value</th> </tr> </thead> <tbody> <tr> <td>Priority inactive (no control)</td> <td>0 (00_{bin})</td> </tr> <tr> <td>Priority ON (control: enable, on)</td> <td>3 (11_{bin})</td> </tr> <tr> <td>Priority OFF (control: disable, off)</td> <td>2 (10_{bin})</td> </tr> </tbody> </table> 1-byte 0 ... 255	Function	value	Priority inactive (no control)	0 (00 _{bin})	Priority ON (control: enable, on)	3 (11 _{bin})	Priority OFF (control: disable, off)	2 (10 _{bin})
Function	value									
Priority inactive (no control)	0 (00 _{bin})									
Priority ON (control: enable, on)	3 (11 _{bin})									
Priority OFF (control: disable, off)	2 (10 _{bin})									
<i>If the condition is met</i>	<i>no telegram</i> send following telegram once <i>send cyclically</i>	Send response if channel condition is fulfilled.								
<i>Telegram</i>	ON OFF <i>no priority</i> priority, ON (down) <i>priority, OFF (up)</i> Telegram 0 ... 255	Type of telegram for the second output object on the channel with fulfilled condition. For telegram type Switching command. For telegram type Priority. For telegram type Value								
<i>If the condition is not met</i>	<i>no telegram</i> send following telegram once <i>send cyclically</i>	Send response if channel condition is unfulfilled.								
<i>Telegram</i>	ON OFF <i>no priority</i> priority, ON (down) priority, OFF (up) Telegram 0 .. 255	Type of telegram for the second output object on the channel with unfulfilled condition. For telegram type Switching command. For telegram type Priority. For telegram type Value								

Continuation:

Designation	Values	Description
<i>Activate lock function</i>	<i>Yes</i>	Insert disable parameter and disable object.
	<i>no</i>	No disable function
<i>Response when setting disable</i>	<i>do not send</i>	No telegrams as long as the disable object is set.
	<i>as with unfulfilled condition</i>	Same reaction set as in parameter <i>If the conditioned has not been fulfilled</i> (see above).
	<i>as with fulfilled condition</i>	Same reaction set as in parameter <i>If the conditioned has been fulfilled</i> (see above).
<i>Behaviour when cancelling the disable function</i>	<i>Do not send</i>	Not automatically resent when the disable function is cancelled
	<i>update channel</i>	The current channel status is sent immediately as soon as the disable function is cancelled.
<i>Cycle time (if used)</i>	<i>do not send cyclically</i> <i>every 1 min</i> <i>every 2 min</i> <i>every 3 min</i> <i>every 5 min</i> <i>every 10 min</i> <i>every 15 min</i> <i>every 20 min</i> <i>every 30 min</i> <i>every 45 min</i> <i>every 60 min</i>	How often should the telegrams for CX.1 and CX.2 be sent?
<i>Telegram with recognised sensor error</i>	<i>Do not send anymore</i> <i>as with unfulfilled condition as</i> <i>with fulfilled condition</i>	This parameter takes effect if the dimension sensor (used by channel) reports an error.

4 Typical applications:

These typical applications are designed to aid planning and are not to be considered as an exhaustive list.

It can be extended and updated as required.

4.1 Simple twilight switch

Outside lighting should come on at dusk and go off again at sunrise.

4.1.1 Devices:

- LUNA 134 KNX (1349200)
- RMG 8 S (4930220)

4.1.2 Overview

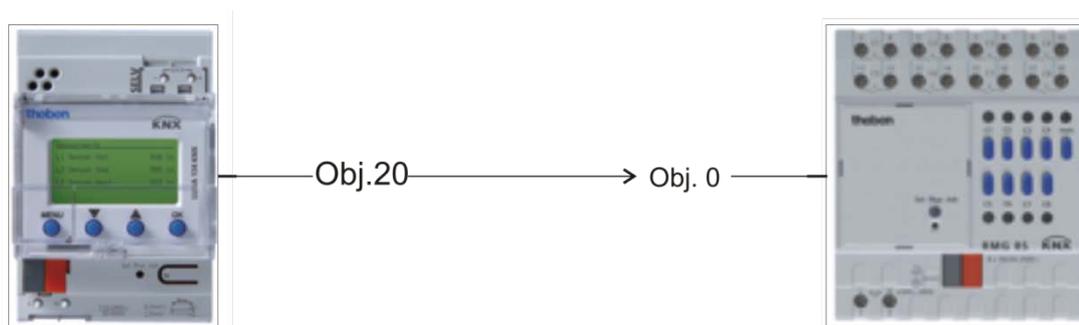


Figure 2

4.1.3 Objects and links

Table 14

No.	LUNA 134 Object name	No.	RMG 8 S Object name	Comment
20	<i>CI.1 Switching channel - switching</i>	0	<i>RMG 8 S channel C1 switching object</i>	-

4.1.4 Important parameter settings

Standard or customer-defined parameter settings apply for unlisted parameters.

Table 15: LUNA 134

Parameter page	Parameter	Setting
<i>General</i>	<i>Activate switching channel C1</i>	<i>yes..</i>
<i>Switching channel C1: Function</i>	<i>Brightness threshold value</i>	<i>below 10 lx</i>
	<i>Source</i>	<i>Sensor 1</i>
<i>Objects</i>	<i>Telegram type C1.1</i>	<i>switching command</i>
	<i>If the brightness condition is fulfilled</i>	<i>send cyclically</i>
	<i>Telegram</i>	<i>ON</i>
	<i>If the condition is not met</i>	<i>send cyclically</i>
	<i>Telegram</i>	<i>OFF</i>
	<i>Cycle time (if used)</i>	<i>Every 60 minutes</i>

Table 16: RMG 8 S

Parameter page	Parameter	Setting
<i>General</i>	<i>Type of basic module</i>	<i>RMG 8 S</i>
<i>RMG 8 S channel C1 function selection</i>	<i>Channel function</i>	<i>Switching On/Off</i>
	<i>Activation of function via</i>	<i>Switching object</i>
<i>Contact characteristics</i>	<i>Type of contact</i>	<i>NO contact</i>

4.2 Switching 2-zone internal lighting depending on external brightness.

The lighting in a hall is divided into 2 zones:

- Zone 1 = Front near to the windows.
- Zone 2 = Rear without windows.

Decreasing external lighting enables the lighting in zone 1 to be turned on later than in zone 2. This function is achieved with the help of 2 brightness thresholds and 2 switching channels.

4.2.1 Devices:

- LUNA 134 KNX (1349200)
- RMG 8 S (4930220)

4.2.2 Overview

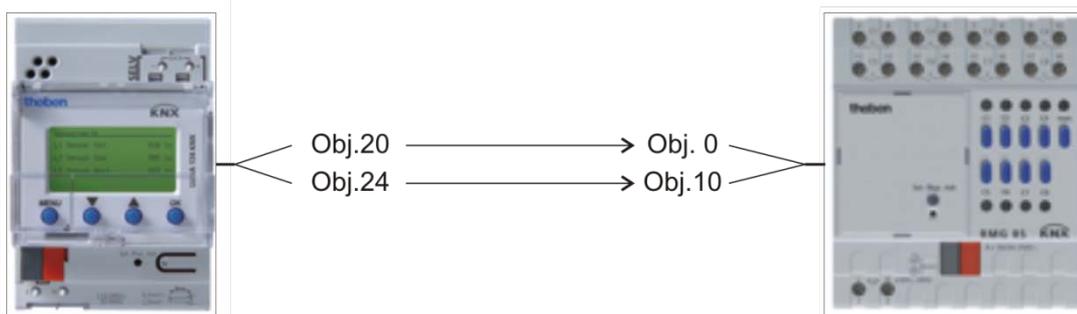


Figure 3

4.2.3 Objects and links

Table 17

No.	LUNA 134 Object name	No.	RMG 8 S Object name	Comment
20	<i>C1.1 Switching channel - switching</i>	0	<i>RMG 8 S channel C1 switching object</i>	Lighting zone 1
24	<i>C2.1 Switching channel - switching</i>	10	<i>RMG 8 S channel C2 switching object</i>	Lighting zone 2

4.2.4 Important parameter settings

Standard or customer-defined parameter settings apply for unlisted parameters.

Table 18: LUNA 134

Parameter page	Parameter	Setting
<i>General</i>	<i>Activate switching channel C1</i>	<i>yes..</i>
	<i>Activate switching channel C2</i>	<i>yes..</i>
<i>Switching channel C1: Function</i>	<i>Brightness threshold value</i>	<i>below 600 lx*</i>
	<i>Source</i>	<i>Sensor 1</i>
<i>Objects</i>	<i>Telegram type C1.1</i>	<i>switching command</i>
	<i>If the brightness condition is fulfilled</i>	<i>send cyclically</i>
	<i>Telegram</i>	<i>ON</i>
	<i>If the condition is not met</i>	<i>send cyclically</i>
	<i>Telegram</i>	<i>OFF</i>
	<i>Cycle time (if used)</i>	<i>Every 60 minutes</i>
<i>Switching channel C2: Function</i>	<i>Brightness threshold value</i>	<i>below 1000 lx*</i>
	<i>Source</i>	<i>Sensor 1</i>
<i>Objects</i>	<i>Telegram type C2.1</i>	<i>switching command</i>
	<i>If the brightness condition is fulfilled</i>	<i>send cyclically</i>
	<i>Telegram</i>	<i>ON</i>
	<i>If the condition is not met</i>	<i>send cyclically</i>
	<i>Telegram</i>	<i>OFF</i>
	<i>Cycle time (if used)</i>	<i>Every 60 minutes</i>

* No responsibility accepted for correctness of this information. The optimum values must be determined based on local circumstances.

Table 19: RMG 8 S


Parameter page	Parameter	Setting
<i>General</i>	<i>Type of basic module</i>	<i>RMG 8 S</i>
<i>RMG 8 S channel C1 function selection</i>	<i>Channel function</i>	<i>Switching On/Off</i>
	<i>Activation of function via</i>	<i>Switching object</i>
<i>Contact characteristics</i>	<i>Type of contact</i>	<i>NO contact</i>
<i>RMG 8 S channel C1 function selection</i>	<i>Channel function</i>	<i>Switching On/Off</i>
	<i>Activation of function via</i>	<i>Switching object</i>
<i>Contact characteristics</i>	<i>Type of contact</i>	<i>NO contact</i>

The first detected sensor is displayed with serial number. A flashing LED on the sensor makes it instantly identifiable without having to make the effort of reading the serial number on the device. The measured brightness value of the sensor is also displayed. This can also be helpful for the allocation of sensors, particularly when they are already installed.

Table 20

Case 1: The displayed sensor is accepted.	Case 2: If you want continue searching rather than accepting the sensor.
<div data-bbox="284 602 679 857" style="border: 1px solid black; padding: 5px;"> <p>L1 sensor 1 SN:104405325 inactive 445 lx next serial number Allocate Back</p> </div> <p>Select <i>allocate</i> and confirm by pressing OK.</p>	<div data-bbox="900 602 1295 857" style="border: 1px solid black; padding: 5px;"> <p>L1 sensor 1 SN:104405325 inactive 445 lx next serial number Allocate Back</p> </div> <p>Select <i>next serial number</i> and confirm by pressing OK.</p>
<p>Leave settings for sensor 1 by pressing <i>Back</i>.</p> <div data-bbox="284 1077 679 1332" style="border: 1px solid black; padding: 5px;"> <p>L1 sensor 1 SN:104405325 445 lx Deactivate next serial number Back</p> </div> <p>An incorrectly allocated sensor can be separated at any time via the menu item <i>Deactivate</i>.</p>	<p>Another sensor is found. Select using <i>Allocate</i> or search for another via <i>Next serial number</i>.</p> <div data-bbox="900 1115 1295 1370" style="border: 1px solid black; padding: 5px;"> <p>L1 sensor 1 SN:104405340 inactive 445 lx next serial number Allocate Back</p> </div>
<div data-bbox="592 1516 989 1771" style="border: 1px solid black; padding: 5px;"> <p>Process sensors L1 sensor 1 SN:104405325 L2 sensor 2 inactive L3 sensor 3 inactive Back</p> </div> <p>Set the second sensor using <i>L2 sensor 2</i> or leave the sensor menu by pressing <i>Back</i>.</p>	

6 Operating instructions

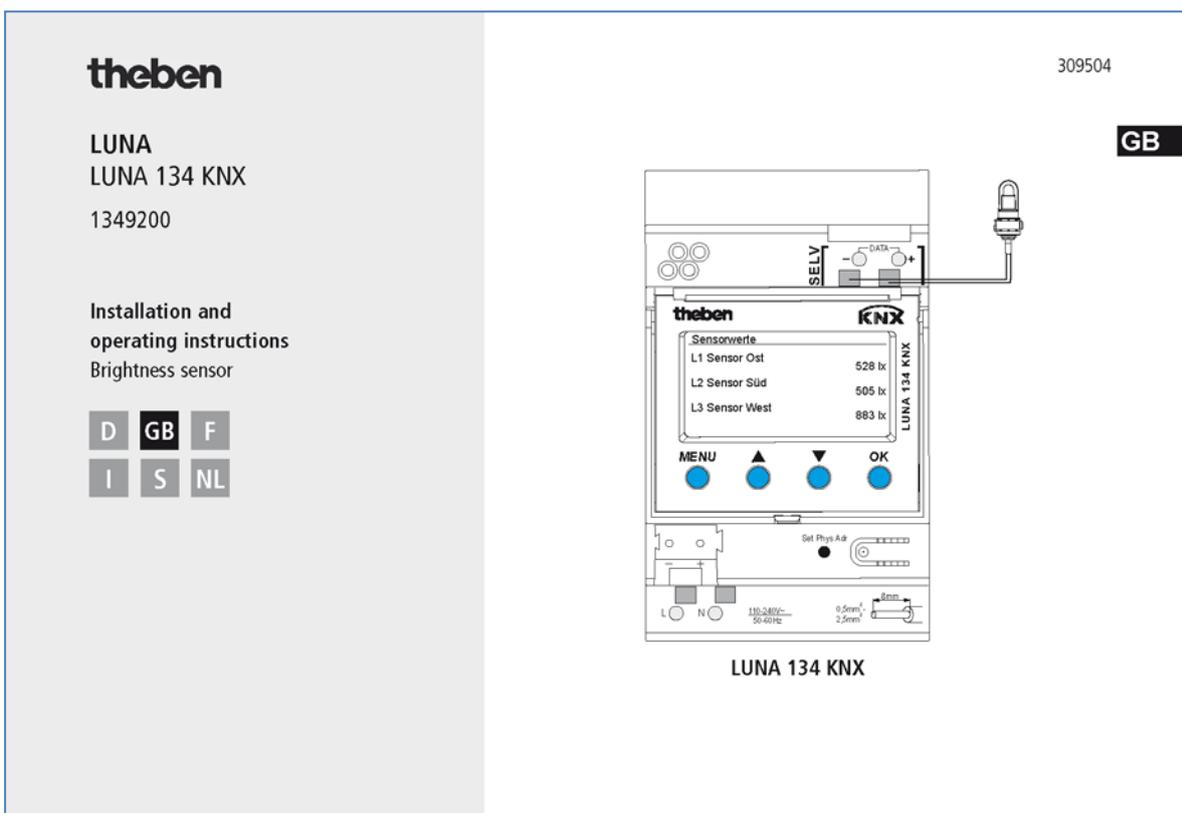

Contents

Basic safety instructions	3
Display and keys	4
Connection/installation	5
Bus connection, programming physical address	6
Start-up 7	
Home page – Sensor values	7
Enter PIN	
Menu – Settings..	8
Language..	9
Display..	9
System..	10
Sensors..	11
Deactivate active sensor	11
Allocate new serial number to active sensor	12
Menu – Switching channels..	13
Select light threshold (brightness)	14
Select delay	15
Technical date	16
Service address/Hotline	16

2

Basic safety instructions

GB



WARNING

Danger of death through electric shock or fire!

➤ Installation should only be carried out by a professional electrician!

- The device is designed for installation on DIN top hat rails (in accordance with EN 60715); device conforms with EN 60669-1
- Professional installation of bus lines and commissioning of devices requires compliance with the provisions of EN 50428 for switches or similar installation equipment for use in building systems technology. Tampering with, or making modifications to, the device will invalidate the guarantee.

Designated use


- The device registers the brightness via up to 3 external brightness sensors; the measured values are transmitted via the bus.
- Only use the device in enclosed, dry spaces; brightness sensors are installed in the open-air.

Disposal

Dispose of device in environmentally sound manner

3

Screen and keys

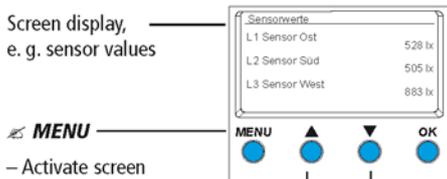

Screen display,
e. g. sensor values

MENU


- Activate screen
- Open menu
- Cancel menu
- ESC (1 step back)

Options
are displayed

OK

- Store selection
- Confirm selection

Connection/installation

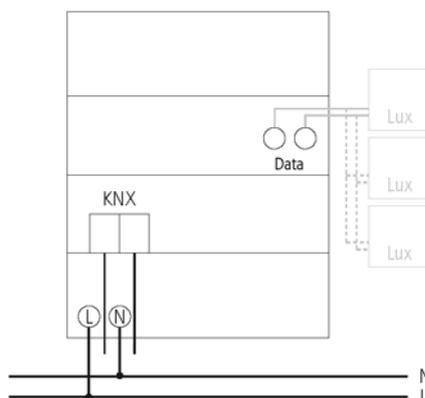

4

Connection/installation

GB




WARNING

Danger of death through electric shock!

- Must only be installed by professional electrician!
- Disconnect power source!
- Cover or shield any adjacent live components.
- Ensure device cannot be switched again!
- Check power supply is disconnected!
- Earth and bypass!
- Observe SELV on data bus.

Connect cable


- Strip cable by 8 mm (max. 9 mm).
- Insert cable at 45° in the open terminal (2 cables per terminal position possible).
- With flexible wires only: To open the spring terminal, press screwdriver downwards.

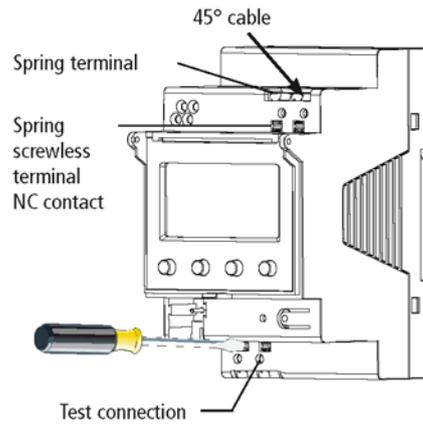

5

Bus connection

- Insert bus line in the front of the device.
- Ensure correct polarity.

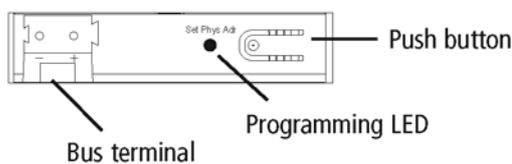

6

Program physical address



- Press button on front of the device.
 - The programming LED lights up.
 - Device is in program mode.

Start-up, diagnostics and configuration are handled by ETS 3 and 4 (KNX tool software).

Start-up

GB

The pages displayed depends on the programming by the ETS. Please refer to the Product Handbook for detailed functional descriptions (at www.theben.de).



Home page – Sensor values



If an external sensor is connected, the sensor value (lux value) appears on screen. The sensor LED flashes.

Enter PIN

If Access via PIN is set on the ETS, the pin code (1000–9999) has to be entered before use.

- Enter the numbers with ▼ or ▲ and confirm with **OK**.

7




Menu – Settings..

The **Settings** menu item can be used for setting the language, screen lighting or information on the device and sensors.

- Press **MENU** button.
This brings up **Settings..**
- Confirm **settings..** by pressing **OK**.
- Use ▼ or ▲ to select language, display etc.
- Press **OK** to confirm or use ▼ or ▲ to select **Back**.


8



Settings– Set language

GB


- Use ▼ or ▲ to select language.
- Press *OK* to confirm.
- Use ▼ or ▲ to select desired language.



Settings– Set display

- Use ▼ or ▲ to select display.
- Press *OK* to confirm.

9



Settings – System..

- Use ▼ or ▲ to select system.
- Press *OK* to confirm.

The display shows

Prog. mode (Programming mode)

PA (Physical address)


SW (Software version)

SN (Serial number)

FD (Finishing date)

HW (Hardware)

10




Settings – Sensors..

GB

- Use ▼ or ▲ to select sensors.
- Confirm by pressing **OK**.

The **Sensors** menu item can be used to display the lux values for up to 3 connected sensors. The designation of the sensors can be changed using the ETS:


- active (serial number is displayed)
- inactive (sensor is not required)
- Error (sensor does send)



Deactivate active sensor

- Use ▼ or ▲ to select the desired sensor.
- Confirm L1 sensor 1 (active) by pressing **OK**. This brings up serial numbers, lux value and **Deactivate**.
- Use ▼ or ▲ to select **Deactivate**.
- Confirm by pressing **OK**.

11




Allocate new serial number to inactive sensor

- Use ▼ or ▲ to select **Next serial number**.
- Press **OK** to confirm.

The inactive sensor displays a new SN number.


- Use ▼ or ▲ to select **Allocate**.
- Press **OK** to confirm and, if reqd., select **Back** to leave menu.




If you want continue searching rather than accepting the sensor..

- Select **Next serial number**.
- Press **OK** to confirm.

12



↓




Menu – Switching channels..

GB


The **Switching channels** menu item displays the status of the channel (ON, OFF, disabled/invalid):

- Press **MENU** button.
This brings up Settings.. and the **Switching channels..** etc.
- Use ▼ or ▲ **K1**: to select **Switching channel 1.**
- Press **OK** to confirm. It brings up **Status (ON, OFF), Light thresholds..** and **Next channel...**

13



↓




↓

Select light thresholds (brightness)

The **Light thresholds** menu item can be used to set of the brightness of the relevant channel:

- Use ▼ or ▲ to select **Light thresholds.**
- Press **OK** to confirm.
- Use ▼ or ▲ to select lux value.
- Press **OK** to confirm.
- Use ▼ or ▲ to change lux value.
- Press **OK** to confirm desired lux value.

14



Select delay

The Delay menu item can be used to set the delay time:

GB

- Use ▼ or ▲ to select Delay.
- Press **OK** to confirm.
- Use ▼ or ▲ to select Exceed or Underrun.
- Press **OK** to confirm selection.
- Use ▼ or ▲ to change the delay values.
- Press **OK** to select desired delay value.

15

Technical data

- Operating voltage: 110–240 V~, +10 %/-15 %
- Frequency: 50–60 Hz
- Power consumption: typically 1 W
- Standby min.: 0.8 W
- Data output: Safety Extra Low Voltage (SELV)
- Permissible ambient temperature: -5 °C ... +45 °C
- On/Off switching delay: 0–20 min
- Brightness measuring range: 1–100000
- Protection class: II subject to correct installation
- Protection rating: IP 20 in accordance with EN 60529
- Pollution level: 2
- Max. cable cross section: 2.5 mm²
- Operating voltage KNX: bus voltage ≤10 mA
- Cable length: 100 m (YCYM 2 x 2 x 0.8 mm 2 pairs for DATA bus)
50 m (YCYM 2 x 2 x 0.8 mm 1 pair each for KNX and

DATA bus)

- Max. number of connectable brightness sensors for LUNA 134 KNX at DATA bus: 3

Service address

Theben AG
 Hohenbergstr. 32
 72401 Haigerloch
 DEUTSCHLAND
 Phone +49 (0) 74 74/6 92-0
 Fax +49 (0) 74 74/6 92-150

Hotline

Telephone +49 (0) 74 74 6 92 369
 Fax +49 (0) 74 74 6 92 207
 hotline@theben.de
 Addresses, telephone numbers etc.
www.theben.de

16